

Stairs:

Stairs shall be constructed as per the provisions of the Residential Code of New York State.

Width:

Stairways shall not be less than thirty six (36) inches (914mm) in clear width at all points above the permitted handrail height and below the required headroom height.

Risers:

The maximum riser shall be no greater than eight and one quarter (8 $\frac{1}{4}$) inches (209mm). The greatest riser height shall not exceed the smallest by more than three eighths ($\frac{3}{8}$) inch (9.5mm) within any flight of stairs.

Treads:


The minimum tread depth shall be nine (9) inches (229mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projection of the adjacent treads. The greatest shall not exceed the smallest tread depth by more than three eighths ($\frac{3}{8}$) inch (9.5mm) within any flight of stairs.

Landings:

There shall be a landing at the top and bottom of each stairway and shall have a minimum dimension of thirty six (36) inches (914mm) in the direction of travel

Handrails:

Hand rails shall be provided on at least one side of each continuous run of stairs with four (4) or more risers. Handrails shall be continuous for the entire run or flight of stairs. The handrail shall not be less than thirty four (34) inches (864mm) nor more than thirty eight (38) inches (965mm) and shall be measured vertically from tread nosing or landing surface. Handrails running adjacent to walls shall have a space not less than one and one half (1 $\frac{1}{2}$) inches between the wall and the hand rail.

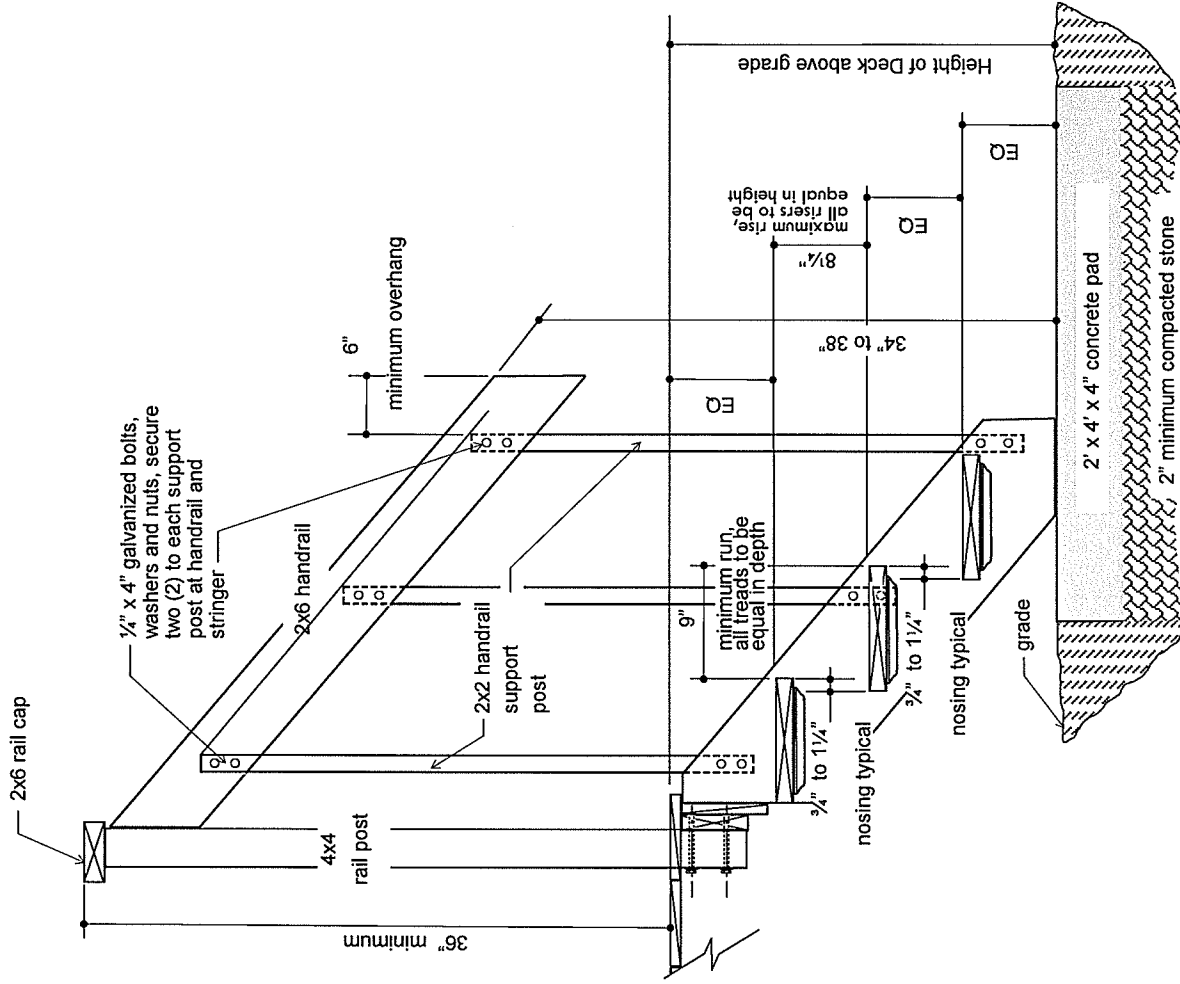

Section B - B